


## PLAN

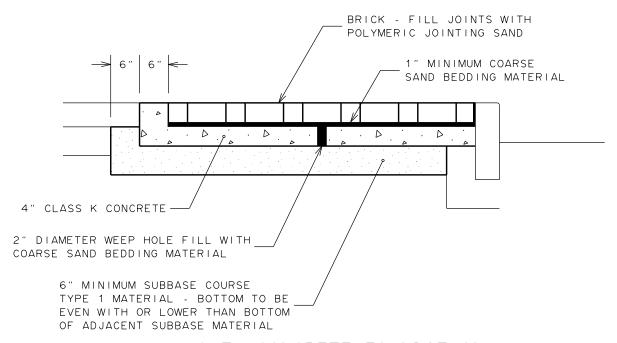

## WITH CONCRETE FOUNDATION

## NOTES:

- 1. MAXIMUM CROSS-SLOPE OF BRICK SIDEWALK IS 1:50.
- 2. PROVIDE ½ INCH WIDE EXPANSION JOINT BETWEEN NEW BRICK CONSTRUCTION AND BACK EDGE CURB, CONCRETE GUTTER, OTHER PAVED AREAS, BUILDINGS, WALLS, POLE BASES AND OTHER STRUCTURES/APPURTENANCES.
- 3. FOR EXPANSION JOINT USE  $\frac{1}{2}$  INCH WIDE PREMOULDED EXPANSION JOINT MATERIAL, SEALED WITH  $\frac{1}{2}$  INCH WIDE CAULKING SEALANT  $\frac{1}{8}$  INCH DEEP.
- 4. WHERE OPTIONAL CONCRETE FOUNDATION IS INSTALLED, WEEP HOLES ARE TO BE INSTALLED FOR EVERY 100 SQUARE FEET OF BRICK AREA AND AT ALL LOW POINTS.

